

## Test Report

SPONSOR: **Finelite**  
Union City, CA

Sound Absorption  
**RAL™-A19-509**

CONDUCTED: 2019-12-09

Page 1 of 10

ON: HP-2 Acoustic Baffle Lit, 8 in. (8 units spaced 18 in. on center)

### TEST METHODOLOGY

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-17: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-16: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

### INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as HP-2 Acoustic Baffle Lit, 8 in. (8 units spaced 18 in. on center). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

#### Product Under Test

Trade Name: HP-2 Acoustic Baffle Lit, 8 in.  
Manufacturer: Finelite

### SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

#### Test Specimen

Materials: Metal fixtures inserted in semirigid felt panel enclosures  
Dimensions: 8 @ 200 mm (7.875 in.) x 2478 mm (97.56 in.)  
Thickness: Overall @ 83.39 mm (3.283 in.) each  
Enclosure walls @ 12.32 mm (0.485 in.) each  
Overall Weight: 80.97 kg (178.5 lbs)

## Test Report

**Finelite**  
2019-12-09

**RAL™-A19-509**  
Page 2 of 10

### Physical Measurements (per unit)

Dimensions: 0.2 m (7.875 in) wide by 2.48 m (97.562 in) long  
Thickness: 0.08 m (3.283 in)  
Weight: 10.12 kg (22.3 lbs)

### Test Environment

Room Volume: 291.98 m<sup>3</sup>  
Temperature: 21.5 °C ± 0.2 °C (Requirement: ≥ 10 °C and ≤ 5 °C change)  
Relative Humidity: 61.7 % ± 0.2 % (Requirement: ≥ 40 % and ≤ 5 % change)  
Barometric Pressure: 97.0 kPa (Requirement not defined)

Each sound absorbing unit had an absorptive area (all exposed surfaces) of 1.44 m<sup>2</sup> (15.48 ft<sup>2</sup>). The total absorptive area (all exposed surfaces) of all sound-absorbing units was 11.5 m<sup>2</sup> (123.83 ft<sup>2</sup>). The array of units covered 8.14 m<sup>2</sup> (87.57 ft<sup>2</sup>) of the horizontal test surface (total treated area).

### MOUNTING METHOD

Type J Mounting: The specimen is an array of 8 spaced sound absorbing fixtures suspended atop an array of cables such that the closest face of the fixtures is located approximately 1511.3 mm (59.5 in.) above the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The fixtures were arranged in a single row, spaced 457.2 mm (18 in.) on center.

## Test Report

**Finelite**  
2019-12-09

**RAL™-A19-509**  
Page 3 of 10



Figure 1 – Specimen mounted in test chamber



Figure 2 – Detail of specimen materials

## Test Report

**Finelite**  
2019-12-09

**RAL™-A19-509**  
Page 4 of 10



Figure 3 – Underside of individual fixture

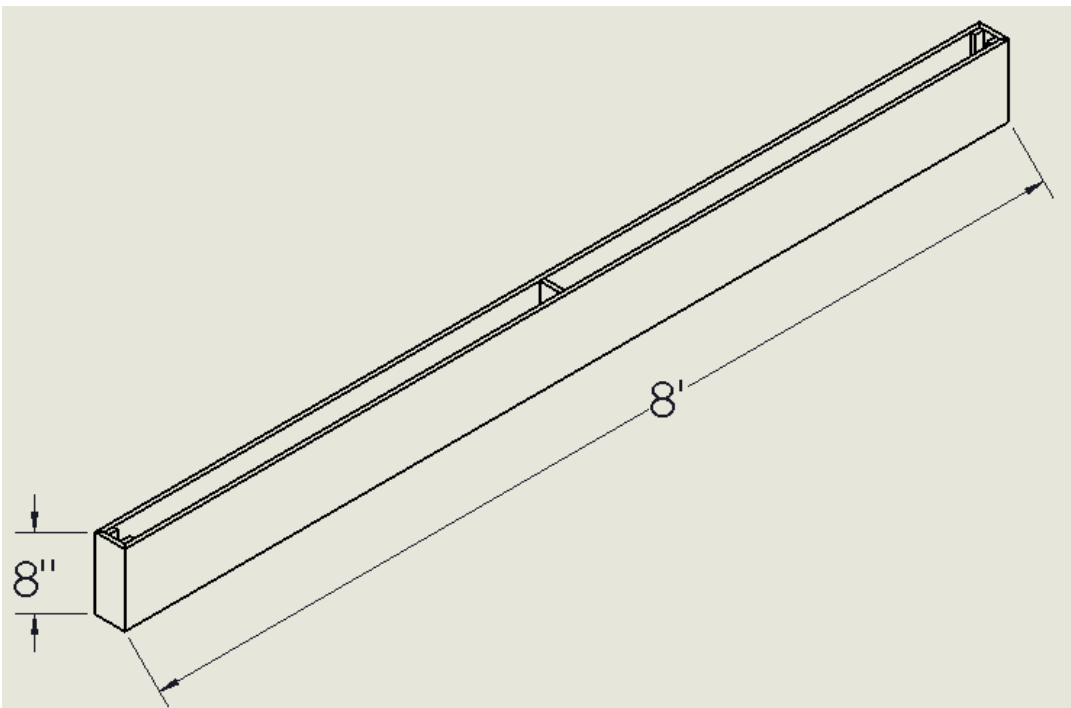


Figure 4 – Product drawing provided by test sponsor

## Test Report


**Finelite**  
2019-12-09

**RAL™-A19-509**  
Page 5 of 10


### TEST RESULTS

Note: There is currently no standardized method for calculating Absorption Coefficients from spaced object absorbers. The sound absorption performance of spaced object absorbers should not be compared directly with specimens tested as a single rectangular area (e.g. mounting types A, E, etc.).

1/3 Octave Center Frequency (Hz)	Total Absorption		Absorption per Unit	
	(m <sup>2</sup> )	(Sabins)	(m <sup>2</sup> / Unit)	(Sabins / Unit)
100	0.34	3.70	0.04	0.46
** 125	1.09	11.78	0.14	1.47
160	0.89	9.57	0.11	1.20
200	1.55	16.66	0.19	2.08
** 250	1.77	19.02	0.22	2.38
315	2.69	28.95	0.34	3.62
400	3.13	33.74	0.39	4.22
** 500	3.97	42.77	0.50	5.35
630	4.74	50.98	0.59	6.37
800	5.85	62.97	0.73	7.87
** 1000	7.20	77.47	0.90	9.68
1250	8.17	87.95	1.02	10.99
1600	8.81	94.84	1.10	11.85
** 2000	9.21	99.18	1.15	12.40
2500	9.63	103.69	1.20	12.96
3150	9.66	103.93	1.21	12.99
** 4000	9.77	105.18	1.22	13.15
5000	9.60	103.35	1.20	12.92

Tested by   
Marc Sciaky  
Senior Experimentalist

Report by   
Malcolm Kelly  
Test Engineer, Acoustician

Approved by   
Eric P. Wolfram  
Laboratory Manager



1512 S BATAVIA AVENUE  
GENEVA, IL 60134  
630-232-0104

An  ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM


FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

Test Report

Finelite  
2019-12-09

RAL™-A19-509  
Page 6 of 10

**SOUND ABSORPTION REPORT**  
HP-2 Acoustic Baffle Lit, 8 in. (8 units spaced 18 in. on center)

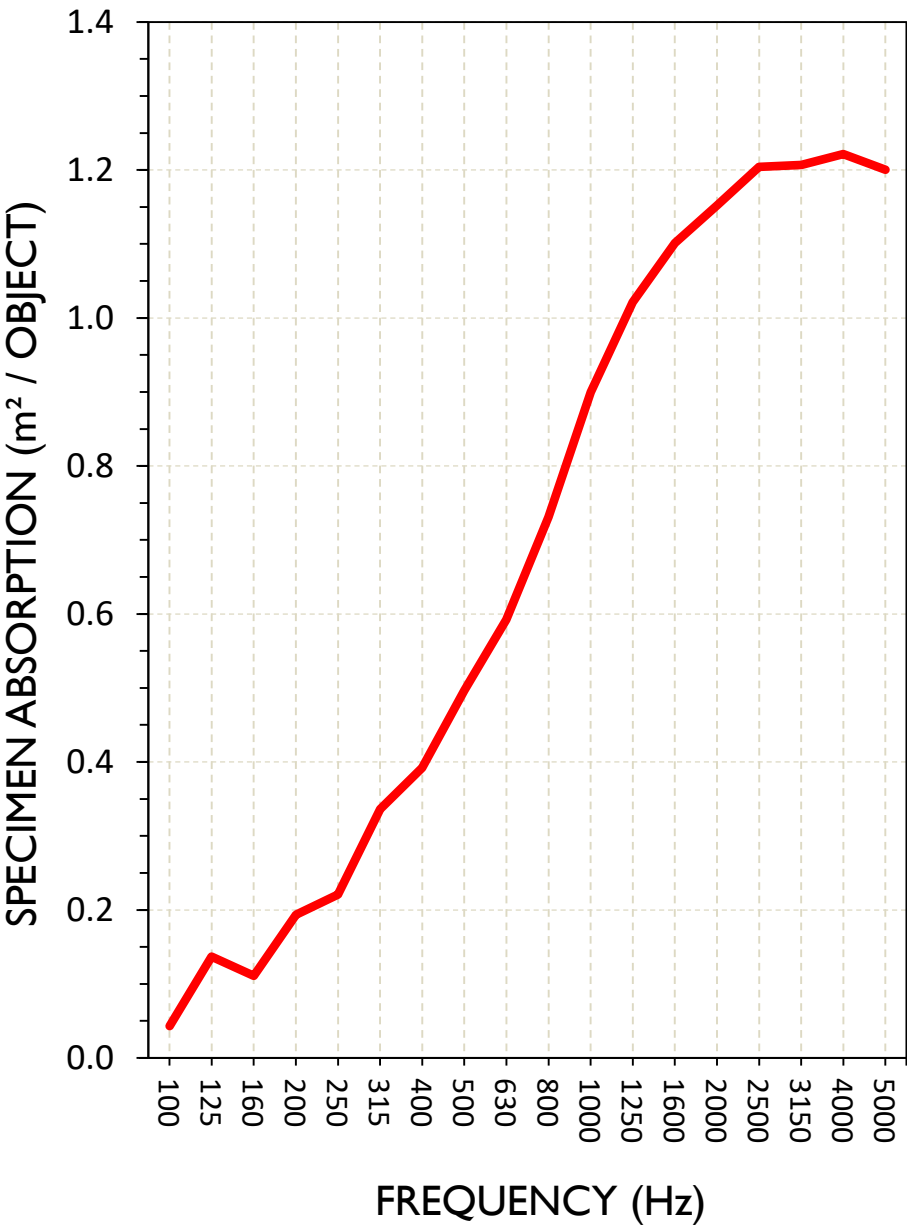

## Test Report

**Finelite**  
2019-12-09

**RAL™-A19-509**  
Page 7 of 10

### **APPENDIX A: Extended Frequency Range Data**

Specimen: HP-2 Acoustic Baffle Lit, 8 in. (8 units spaced 18 in. on center) (See Full Report)

*The following non-accredited data were obtained in accordance with ASTM C423-17, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.*

1/3 Octave Band Center Frequency (Hz)	Total Absorption		Absorption per Unit	
	(m <sup>2</sup> )	(Sabins)	(m <sup>2</sup> / Unit)	(Sabins / Unit)
31.5	1.14	12.24	0.14	1.53
40	-0.53	-5.66	-0.07	-0.71
50	0.14	1.49	0.02	0.19
63	0.79	8.54	0.10	1.07
80	0.56	6.07	0.07	0.76
100	0.34	3.70	0.04	0.46
125	1.09	11.78	0.14	1.47
160	0.89	9.57	0.11	1.20
200	1.55	16.66	0.19	2.08
250	1.77	19.02	0.22	2.38
315	2.69	28.95	0.34	3.62
400	3.13	33.74	0.39	4.22
500	3.97	42.77	0.50	5.35
630	4.74	50.98	0.59	6.37
800	5.85	62.97	0.73	7.87
1000	7.20	77.47	0.90	9.68
1250	8.17	87.95	1.02	10.99
1600	8.81	94.84	1.10	11.85
2000	9.21	99.18	1.15	12.40
2500	9.63	103.69	1.20	12.96
3150	9.66	103.93	1.21	12.99
4000	9.77	105.18	1.22	13.15
5000	9.60	103.35	1.20	12.92
6300	9.26	99.64	1.16	12.45
8000	8.79	94.65	1.10	11.83
10000	7.75	83.39	0.97	10.42
12500	6.96	74.94	0.87	9.37

**Test Report****Finelite**  
2019-12-09**RAL™-A19-509**  
Page 8 of 10**APPENDIX B: Instruments of Traceability**

Specimen: HP-2 Acoustic Baffle Lit, 8 in. (8 units spaced 18 in. on center) (See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
System 1	Type 3160-A-042	3160- 106968	2019-06-25	2020-06-25
Bruel & Kjaer Mic And Preamp A	Type 4943-B-001	2311428	2019-09-27	2020-09-27
Bruel & Kjaer Pistonphone	Type 4228	2781248	2019-08-09	2020-08-09
Omega Digital Temp., Humid. And Pressure Recorder	OM-CP- PRHTemp2000	P97844	2019-02-08	2020-02-08

**APPENDIX C: Revisions to Original Test Report**

Specimen: HP-2 Acoustic Baffle Lit, 8 in. (8 units spaced 18 in. on center) (See Full Report)

<u>Date</u>	<u>Revision</u>
2020-01-02	Original report issued
2020-03-24	Page 1-10: The designation was changed to “HP-2 Acoustic Baffle Lit, 8 in. (8 units, spaced 18 in. on center)” based on certification from the customer that the identified product has not changed in materials, composition, or manufacturing methods since the original test date.

---

END



SPONSOR: **Finelite**  
Union City, CA

Report Referenced: **RAL™-A19-509**  
Page 1 of 2

CONDUCTED: 2019-12-09

ON: HP-2 Acoustic Baffle Lit, 8 in. (8 units spaced 18 in. on center) (See Full Test Report for Details)

#### **Appendix D to ASTM C423 Sound Absorption Test**

Non-standard calculation of equivalent NRC Rating and Absorption Coefficients from spaced absorbers

At this time ASTM C423 does not provide a standard method for determining absorption coefficients of spaced object absorbers. Tests of a set of sound absorbing objects spaced apart from each other will yield higher absorption rates than a specimen joined together as a single patch (A-Mount or E-Mount). For this reason it is unfair to provide NRC or absorption coefficient ratings for specimens that consist of a spaced set of absorbers. Despite this, the architectural industry has expressed great demand for a simple "single number" rating for these treatments. Likewise, acoustical consultants desire equivalent absorption coefficient data for use in acoustical modeling software. The following is an attempt to appease these demands until ASTM develops a standard method for calculation. Several alternate non-standard calculation methods are provided. Riverbank Acoustical Laboratories prefers method 1.

##### **Method 1) Apparent Sound Absorption Coefficient calculated from total test surface area covered**

The total sound absorption yielded by the specimen is divided by the total surface area of the test surface covered by the suspended fixtures, including intermediate spaces. The fixture rigging covered 8.14 m<sup>2</sup> (87.57 ft<sup>2</sup>) of horizontal test surface area. With an extra 373.81 mm (14.717 in.) of width to account for the space between the tested array and what would be the next fixture in a larger array, the surface area comes to 9.06 m<sup>2</sup> (97.54 ft<sup>2</sup>). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This may be the most accurate method for comparing fixture arrays to ceiling tile products. The apparent sound absorption coefficient data can be assigned to a single horizontal surface or plane in acoustical modeling software for approximation of fixture array performance. Such approximations rely on the assumptions that fixture spacing is similar to that of the tested array and that the installation occurs over a perfectly reflective ceiling surface.

##### **Method 2) Apparent Sound Absorption Coefficient calculated from total exposed surface area of specimen**

The total sound absorption yielded by the specimen is divided by the total surface area of all exposed specimen faces (1.44 m<sup>2</sup> (15.48 ft<sup>2</sup>) per fixture x 8 fixtures = 11.5 m<sup>2</sup> (123.83 ft<sup>2</sup>) total surface area). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This method shows the actual absorption occurring at the exposed surfaces, but does not provide a fair comparison with materials mounted as a uniform patch (in A-mount or E-mount).

##### **Method 3) Apparent Sound Absorption Coefficient calculated from one face per fixture**

The total sound absorption yielded by the specimen is divided by the surface area of one side of one large face for each fixture in the specimen (0.50 m<sup>2</sup> (5.38 ft<sup>2</sup>) per fixture x 8 fixtures = 3.97 m<sup>2</sup> (42.68 ft<sup>2</sup>) total surface area). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This method is favored by some material manufacturers since it yields very high NRC figures, but does not provide a fair comparison with other ceiling tile or wall panel products. Riverbank Acoustical Laboratories recommends that results obtained from this method be used for research and comparison purposes only; such results should not be used for marketed claims of product performance.

SPONSOR: **Finelite**  
CONDUCTED: 2019-12-09

Report Referenced: **RAL™-A19-509**

Page 2 of 2

**Appendix D: Data** Note: See full test report for details of mounting position, spacing, and configuration, as these parameters greatly affect sound absorption performance.

Specimen Absorption			Method 1	Method 2	Method 3
Freq. (Hz)	Sabins	Sabins / Unit	Apparent Abs. Coefficient From Total Coverage Area	Apparent Abs. Coefficient From Total Exposed Surface Area	Apparent Abs. Coefficient From One Face/Baffle
31.5	12.24	1.53	0.13	0.10	0.29
40	-5.66	-0.71	-0.06	-0.05	-0.13
50	1.49	0.19	0.02	0.01	0.04
<b>63</b>	8.54	1.07	0.09	0.07	0.20
80	6.07	0.76	0.06	0.05	0.14
100	3.70	0.46	0.04	0.03	0.09
<b>125</b>	11.78	1.47	0.12	0.10	0.28
160	9.57	1.20	0.10	0.08	0.22
200	16.66	2.08	0.17	0.13	0.39
<b>250</b>	19.02	2.38	0.19	0.15	0.45
315	28.95	3.62	0.30	0.23	0.68
400	33.74	4.22	0.35	0.27	0.79
<b>500</b>	42.77	5.35	0.44	0.35	1.00
630	50.98	6.37	0.52	0.41	1.19
800	62.97	7.87	0.65	0.51	1.48
<b>1,000</b>	77.47	9.68	0.79	0.63	1.81
1,250	87.95	10.99	0.90	0.71	2.06
1,600	94.84	11.85	0.97	0.77	2.22
<b>2,000</b>	99.18	12.40	1.02	0.80	2.32
2,500	103.69	12.96	1.06	0.84	2.43
3,150	103.93	12.99	1.07	0.84	2.43
<b>4,000</b>	105.18	13.15	1.08	0.85	2.46
5,000	103.35	12.92	1.06	0.83	2.42
6,300	99.64	12.45	1.02	0.80	2.33
<b>8,000</b>	94.65	11.83	0.97	0.76	2.22
10,000	83.39	10.42	0.85	0.67	1.95
12,500	74.94	9.37	0.77	0.61	1.76
Apparent NRC:			<b>0.60</b>	<b>0.50</b>	<b>1.40</b>
Apparent SAA:			<b>0.61</b>	<b>0.48</b>	<b>1.40</b>

Prepared by   
Malcolm Kelly  
Test Engineer, Acoustician